

Alma Mater Studiorum Università di Bologna
Archivio istituzionale della ricerca

Vibroacoustic Measurements for Detecting Water Leaks in Buried Small-Diameter Plastic Pipes

This is the final peer-reviewed author's accepted manuscript (postprint) of the following publication:

Published Version:

Alberto, M., Marco, T., Alessandro, R. (2017). Vibroacoustic Measurements for Detecting Water Leaks in Buried Small-Diameter Plastic Pipes. JOURNAL OF PIPELINE SYSTEMS ENGINEERING AND PRACTICE, 8(4), 1-10 [10.1061/(ASCE)PS.1949-1204.0000287].

Availability:

This version is available at: <https://hdl.handle.net/11585/605704> since: 2018-01-09

Published:

DOI: [http://doi.org/10.1061/\(ASCE\)PS.1949-1204.0000287](http://doi.org/10.1061/(ASCE)PS.1949-1204.0000287)

Terms of use:

Some rights reserved. The terms and conditions for the reuse of this version of the manuscript are specified in the publishing policy. For all terms of use and more information see the publisher's website.

This item was downloaded from IRIS Università di Bologna (<https://cris.unibo.it/>).
When citing, please refer to the published version.

(Article begins on next page)

This is the final peer-reviewed accepted manuscript of:

Martini Alberto, Troncosi Marco, Rivola Alessandro

Vibroacoustic Measurements for Detecting Water Leaks in Buried Small-Diameter Plastic Pipes

In: Journal of Pipeline Systems Engineering and Practice, 2017, 8 (4): 04017022

The final published version is available online at:

[https://doi.org/10.1061/\(ASCE\)PS.1949-1204.0000287](https://doi.org/10.1061/(ASCE)PS.1949-1204.0000287)

Rights / License:

The terms and conditions for the reuse of this version of the manuscript are specified in the publishing policy. For all terms of use and more information see the publisher's website.

This item was downloaded from IRIS Università di Bologna (<https://cris.unibo.it/>)

When citing, please refer to the published version.

Vibroacoustic measurements for detecting water leaks in buried small-diameter plastic pipes

Alberto Martini¹, Marco Troncosi² and Alessandro Rivola³

¹ Assistant Professor, DIN – Dept. of Industrial Engineering, University of Bologna, Viale del Risorgimento 2, 40136 Bologna, Italy (corresponding author). E-mail: alberto.martini6@unibo.it

² Assistant Professor, DIN – Dept. of Industrial Engineering, University of Bologna, Viale del Risorgimento 2, 40136 Bologna, Italy. E-mail: marco.troncosi@unibo.it

³ Associate Professor, DIN – Dept. of Industrial Engineering, University of Bologna, Viale del Risorgimento 2, 40136 Bologna, Italy. E-mail: alessandro.rivola@unibo.it

Abstract: Leak detection is an essential topic within the policies of water losses management in drinking water supply networks. This paper reports the results of an experimental campaign performed for assessing the sensitivity to water leaks of measurements of different vibro-acoustic phenomena. The study represents the first stage of a research aimed at developing a device for the automatic leak detection in service pipes of water distribution networks. Leaks were artificially induced on a plastic pipe (length of 28 m, diameter of 32 mm) of a buried experimental facility. Vibro-acoustic phenomena related to the leaking flow were monitored by using a hydrophone and two accelerometers. A satisfactory leak detection performance was achieved by processing the signals of both kinds of transducers.

Author keywords: Water-filled pipe; Plastic service pipe; Vibration monitoring; Leak detection.

Introduction

The efficiency of water distribution network is significantly decreased by water losses, which frequently exceed even 30% of the input volume (BDEW 2010; EPA 20102010), and in certain cases may reach much higher levels, up to 50-60% (Kanakoudis and Tsitsifli 2010 and 2014; Kanakoudis et al. 2013;), and even peak at over 70% (Kanakoudis and Muhammetoglu 2014). Since the largest part of water losses is ascribable to leaks or pipe breaks (i.e. resulting from pipe holes

26 and damages), real losses being generally more than 50% of Non-Revenue Water (Kanakoudis and
27 Tolikas 2001; Kanakoudis 2004), proper policies to manage such leaks are essential.

28 Many approaches and technologies have been proposed for achieving leak detection and
29 location, in order to implement Active Leakage Control strategies (Hunaidi et al. 2000; Gao et al.
30 2005; Suzuki et al. 2005; Metje et al. 2007; Anastasopoulos et al. 2009; Fahmy and Moshelhi 2009;
31 Bimpas et al. 2010; Ghazali et al. 2012; Cataldo et al. 2014; Yazdekhashti et al. 2016). The most
32 widespread techniques, which are ordinarily adopted to carry on leak detection and repair programs
33 in practice, are based on the monitoring of vibro-acoustic phenomena generated by active leaks.

34 Several factors are commonly considered as potential sources of leak-related noise, even if
35 the physical mechanism of noise generation is not yet completely understood. Turbulent condition
36 of the leaking flow is proven to be a relevant source of noise (Papastefanou et al. 2012). Some
37 experiments suggest that the medium the water leaks into may significantly affect noise and
38 vibration levels (Thompson et al. 2001; Vahaviolos et al. 2001). Conversely the actual influence of
39 cavitation phenomena is a controversial issue (Anastasopoulos et al. 2009; Khulief et al. 2012;
40 Papastefanou et al. 2012).

41 Nonetheless, the effects of vibro-acoustic phenomena related to water leaks and the way
42 they propagate along pipelines are well-known. Active leaks can excite the vibrational modes
43 characterizing fluid-filled pipes. In practical applications low-frequency modes (i.e. well below the
44 pipe ring frequency) are mostly responsible for the observed leak noise, namely three axisymmetric
45 waves (order $n=0$) and the $n=1$ wave, which is related to beam bending (Fuller and Fahy 1982;
46 Muggleton et al. 2002; Gao et al. 2004). In particular, propagation of vibrational energy is mainly
47 ascribable to the two axisymmetric waves termed $s=1$ and $s=2$ respectively (Pavic 1992; Muggleton
48 and Brennan 2005): the former is preponderantly a fluid-borne wave; the latter mainly involves
49 axial deformations of the pipe shell. These waves are coupled by the Poisson ratio, coupling being
50 weak or strong depending on the characteristic of both the pipe and the surrounding medium
51 (Muggleton et al. 2002). The monitoring of fluid pressure waves and pipe vibrations, by means of

52 hydrophones and accelerometers respectively, is effectively adopted for detecting and pinpointing
53 leaks.

54 The present research deals with the detection of leaks in plastic (namely high-density
55 polyethylene, HDPE) small-diameter service pipes of water supply networks. It was promoted and
56 funded by the multi-utility Hera S.p.A. (Bologna, Italy), a company that supplies about $3 \cdot 10^8$ m³
57 per year of drinking water to 237 municipalities (total population of about 4 million), through a
58 network of 35150 km of water mains. Indeed, this class of pipes represents a significant percentage
59 of the service pipes installed in the distribution network. In particular, the multi-utility started using
60 HDPE pipes for all the new connections about two decades ago. Moreover, since then all the leaks
61 detected in service pipes have been repaired by completely replacing the old pipes with new HDPE
62 ones. Although leaks in service pipes typically exhibit low flow rates, their total runtime (i.e. the
63 total period to the burst repair) is generally longer than for large leaks. This leads to high overall
64 losses as well (Butler 2000; EPA 2010). Consequently, they represent significant costs and require
65 the development of proper strategies to manage pipe replacement and repair (Kanakoudis and
66 Tolikas 2001). Indeed water losses related to service connections constitute a significant percentage
67 of the total losses affecting the water distribution network managed by the multi-utility, as shown
68 by the company internal reports on maintenance operations. In addition, the effectiveness of the
69 mentioned detection techniques based on vibro-acoustic signals may result considerably reduced in
70 case of plastic pipes (which are being recently installed in water distribution networks), due to a
71 greater signal attenuation with respect to metal pipes (Hunaidi and Chu 1999; Hunaidi et al. 2000;
72 Gao et al. 2004; Pal et al. 2010). Nonetheless, to the authors' best knowledge, not many studies
73 dealt with water leaks in small-diameter pipes (most of the works being concerned with leak
74 detection in large-diameter distribution pipes) and particularly with plastic service pipes, which are
75 frequently characterized by a diameter smaller than 40 mm (CEN 2000). Therefore, the first
76 objective of this work is to carry out a deeper investigation on leak detection for this kind of pipes,
77 with main focus on longitudinal cracks, which are the most common for the network of interest. In

78 particular, leaks are simulated through induced longitudinal cuts, whereas most of the studies
79 simulate leaks by means of drilled holes or by opening valves (e.g. Miller et al. 1999; Yazdekhashti
80 et al. 2016).

81 The second objective is to develop and test a simple and reliable algorithm for leak detection
82 purpose by using vibro-acoustic signals. In particular the algorithm adopts a scalar detection index
83 based on a simple statistical parameter (namely the signal standard deviation), which is computed
84 for steady-state signals measured under the normal network operating conditions, as opposed to
85 methods requiring induced transients or pressure increment (e.g. Anastasopoulos et al. 2009;
86 Colombo et al. 2009). The proposed algorithm works with one single transducer, whereas many
87 know techniques require two distinct sensors, since they are based on signal correlation (e.g. Gao et
88 al. 2004; Yazdekhashti et al. 2016). A proper strategy is developed to overcome possible high
89 incidence of false alerts, a known issue frequently affecting systems relying on one single sensor,
90 such as noise loggers (Hunaidi et al. 2012; Liu et al. 2012).

91 The final goal of the project is the development of a system for automatic early detection of
92 unreported burst leaks occurring in the service connections running from the water main to the
93 users' metering points (Leoni et al. 2009). The system is required to be installed near the customer
94 water meter and to operate at the normal functioning conditions of the network. Detecting leaks
95 with satisfactory reliability is a primary requirement in order to avoid possible false detections,
96 which would result in an unaffordable increment in leak management costs due to unnecessary
97 operations of the maintenance teams. Low cost is one of the essential system requirements too, due
98 to the planned widespread installation. Hence, very simple hardware components must be adopted
99 in order to meet cost requirements (Martini et al. 2014). The developed algorithm is suitable to meet
100 such requirements, as it relies on rather basic analysis techniques, thus its computational
101 requirements being limited. The system may be integrated with the automatic meter reading (AMR)
102 system, in order to share both the power supply and the data transmission network. Thanks to these
103 characteristics, and since cheaper and cheaper sensors and electronics are constantly becoming

104 available, the multi-utility estimates that monitoring service pipes may become economically
105 convenient within the next decade.

106 An experimental campaign was carried out for assessing the effectiveness of measurements
107 of different vibro-acoustic phenomena for leak detection purpose, as well as the performance of the
108 detection algorithm based on such measurements. The experimental tests were performed on a
109 buried test facility of the multi-utility Hera S.p.A. that simulated a typical customer connection
110 branch of the network. Water leaks were artificially induced on a small-diameter HDPE pipe.
111 Signals in both leaking and non-leaking conditions were measured by means of two accelerometers
112 and a hydrophone. The leak detection performance was assessed for leaks located at different
113 distances from the transducers. This paper describes the experimental setup, the test protocols and
114 the techniques adopted for the analyses, and reports the most relevant results of the study.

115 **Experimental setup and tests**

116 The test facility used for the experiments simulates a portion of the water distribution
117 network (Fig. 1). One polyvinyl chloride (PVC) pipe with outer diameter of 90 mm (DN 90) is used
118 as water main. Several plastic pipes of smaller diameter (DN 32) are connected to the larger one as
119 customers' service pipes. Two-way shut-off valves are installed at both extremities of each service
120 pipe, inside manholes. All the pipelines are buried under about 0.5 m of soil. The rig is fed by a
121 pressure tank which permits to regulate water pressure.

122 All measurements were performed on a HDPE pipe of length 28 m (the typical length of the
123 service pipes installed in the water supply network operated by HERA S.p.A. being about 10 m).
124 Tests were carried out on a pipe nearly three times longer than the average in order to assess the
125 maximum range achievable for leak detection, thus possibly increasing the detection performance
126 on standard 10 m long service pipes. The pressure was kept constant at about 3.5 bar, which is the
127 typical functioning condition of the network.

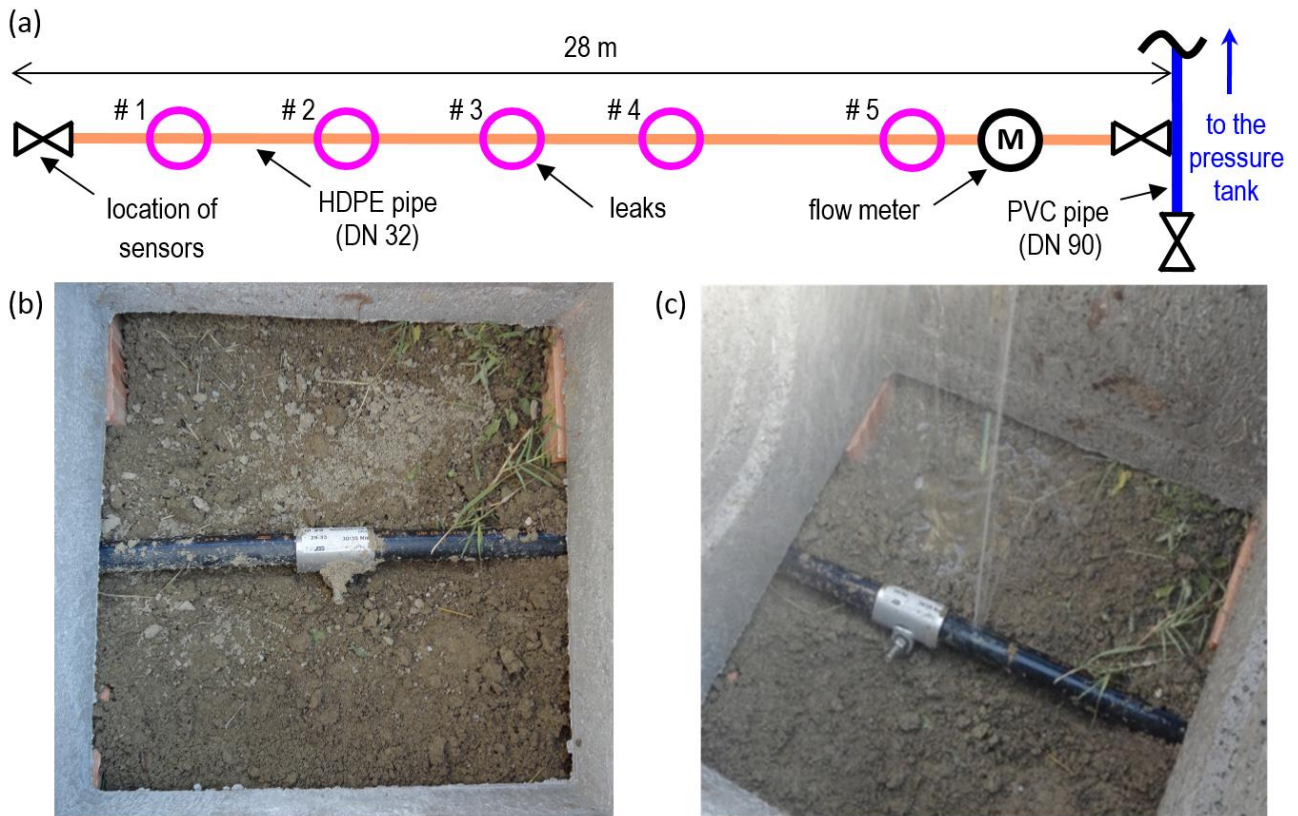


Fig.1. Experimental facility: (a) schematics of the buried pipeline, (b) a repaired leak and (c) an active leak after removing the repair clamp

Leaks were artificially generated at five different locations along the pipe (Fig. 1a), in order to study the influence on the detection performance of the distance between leaks and transducers. The distance values from the terminal valve are reported in Table 1. The induced damages were 20 mm longitudinal cuts (parallel to the pipe axis), which simulated one the most common kind of cracks characterizing burst leaks occurring in the HDPE service pipes managed by HERA S.p.A., according to its maintenance records. In particular, a 20 mm longitudinal crack is expected to generate a leaking flow of about 200 l/h in the typical network functioning conditions (as determined in preliminary experiments conducted by the multi-utility), which is the target leak rate to detect. Manholes were installed to allow the access to the leak locations. Pipe repair clamps were also installed for each leak. Such devices permitted to rapidly switch between leaking and non-leaking conditions and vice versa (Fig. 1b, c). The leaking flow was monitored by a flow meter


142 installed at the pipe T-joint (Fig. 1a). The measured flow rates are reported in Table 1. Leak #5,
 143 larger than the other ones, had been generated for previous experimental tests and its flow rate was
 144 remarkably higher. Nonetheless, Leak #5 was taken into account as well to assess the effects of a
 145 large but relatively distant leak.

146 Three transducers were mounted on the pipe terminal valve (Fig. 2a), to simulate the sensor
 147 setup possibly achievable in actual service pipes (where the sensors should be installed near the
 148 customer water meter, i.e. distant from the water main). Two Integrated Electronic Piezoelectric
 149 Excitation (IEPE) monoaxial accelerometers (PCB 333B55, sensitivity 1V/g) measured axial (i.e.
 150 longitudinal) and radial shell/wall vibrations respectively. A piezoelectric hydrophone (Wilcoxon
 151 Research H571LD-1A, sensitivity -187 dB, ref. $1\text{V}/\mu\text{Pa}$) monitored fluid-borne leak-related noise.
 152 The hydrophone was fastened directly to the threaded port of the terminal valve, thus preventing
 153 any water flow from exiting the valve.

154 **Table 1.** Main features of the studied water leaks

Leak	Distance [m]	Flow rate [l/h]
#1	3	200
#2	8	295
#3	13	200
#4	18	180
#5	26	4000

155

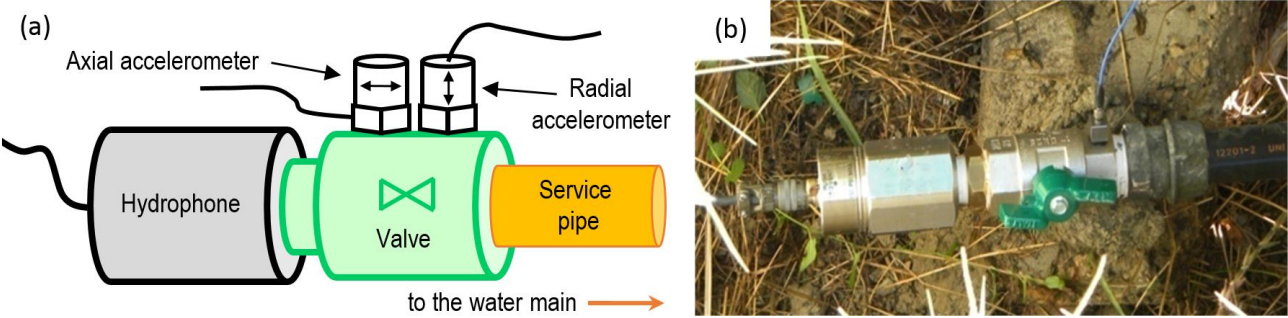

156

157 **Fig. 2.** Sensor setup: (a) schematics, (b) hydrophone and accelerometer close up

158 It is worth noting that the levels of the axial acceleration were expected to be higher than
159 those of the radial acceleration, thus providing better detection performance. Indeed in the
160 frequency band of interest both the $s=1$ and the $s=2$ modes normally exhibits preponderant axial
161 displacements (Pavic 1992). However, unfavorable boundary conditions possibly found in actual
162 pipelines may cause the monitoring of axial vibrations to be unpractical. In addition, the presence of
163 elbow fittings between leak and transducer, while not preventing the detection (Martini et al. 2014),
164 may alter the vibration transmission path. For all these considerations, radial vibrations of the pipe
165 wall were investigated as well.

166 All the signals were simultaneously acquired by means of a LMS SCADAS Recorder SCR-
167 01 (which also provided signal conditioning). The acquisitions were carried out by setting the
168 sampling frequency (F_s) at 5120 Hz and the duration (T_s) at 30 s. Such parameters were determined
169 in preliminary tests performed in the facility, which are not here reported.

170 Measurements were performed for both the non-leaking and the leaking conditions to assess,
171 respectively, the environmental noise and the vibro-acoustic phenomena related to active leaks. The
172 leaking condition was set by temporarily removing a single repair clamp (Fig. 1c), i.e. only one
173 active leak at a time was considered. Two different cases were tested: *Case-A*, water leaking against
174 backfill soil (such a condition was simulated by covering the leaking pipe with a plastic sack filled
175 with soil, which could be easily installed and removed); *Case-B*, water leaking into air. Then the
176 repair clamp was reinstalled again and measurements in non-leaking conditions were carried out.
177 This sequence was repeated for all induced leaks. It is worth noting that during all tests the flow rate
178 inside the pipe was entirely ascribable to the leaking flow of an active leak, in order to simulate a
179 condition of null water consumption by the customers. Indeed the water flow induced by customers'
180 water usage normally generates vibro-acoustic phenomena that hide the leak noise, therefore
181 hampering leak detection. Such test condition does not reduce the reliability of the experiments
182 since, for actual pipelines, it is possible to significantly limit the occurrence of such kind of
183 perturbations by performing nighttime measurements (a practice commonly adopted for leak

184 detection surveys in networks). Furthermore, measurements possibly still affected by environmental
185 noise can be detected and removed from the acquired dataset by using proper signal processing
186 techniques (Martini et al. 2015).

187 **Signal processing and analysis**

188 The analysis took into account only basic techniques, consistently with the project
189 specifications. Indeed low cost is an essential design requirement of the final device for leak
190 detection, since a large number of units should be installed for covering the entire network. In order
191 to reduce the computational resources required to run a detection algorithm on-board (as the device
192 is meant to operate autonomously), hence lowering hardware costs, only simple processing
193 operations are allowed.

194 The acquired signals were processed by using a variant of the prototypal algorithm for
195 automatic leak detection described by Martini et al. (2015). This variant was simply adapted to
196 operate on the sets of acquisitions performed in the different test conditions of the experimental
197 campaign (instead of working on datasets recorded in different consecutive nights). Indeed, many
198 acquisitions were performed for each examined condition, in order to ensure repeatability of
199 measurements, since the signals may result partially affected by environmental perturbations
200 unrelated to the leaks (e.g. noise generated by traffic and industrial activities in the surroundings of
201 the test facility). A very simple statistical parameter, namely the standard deviation of the raw
202 signal (STD), is adopted to define a purpose-built parameter, referred to as *Monitoring Index (MI)*,
203 whose trend is monitored by the algorithm. In particular, the following operations are performed
204 (for further details, see Martini et al. 2015):

- 205 1. The algorithm computes the STD of all the raw signals acquired for any specific dataset.
- 206 2. The *MI* value associated with the j -th analyzed dataset is computed as the average of the STD
207 values of a valid (i.e. without perturbations) subset of the corresponding signals,

$$MI_j = \frac{1}{N} \sum_{k=1}^N (\sigma_{j,k}) \quad (1)$$

where $\sigma_{j,k}$ is the k -th element of the vector including the N lowest STD values of the j -th dataset.

The experiments showed that the selection of a reduced subset of $N = 10$ signals permits to take into account only stationary signals, whereas those featuring anomalous transients are neglected.

3. The MI associated with an active leak is compared with the MI values characterizing the measurements in non-leaking condition. For a better reliability, P different datasets of measurements in non-leaking state are considered, hence obtaining a total amount of P different MI values associated with this condition. The signal levels are expected to rise when an active leak is present, with a resultant increment in the signal STD and in the corresponding MI value (with respect to non-leaking conditions) that allows for leak detection.
4. A further index, referred to as *Monitoring Index Efficiency (MIE)*, is computed for assessing the algorithm efficiency in terms of sensitivity to the n -th leak, and is defined as follows:

$$MIE_n = \frac{MI_{Lk,n}}{\frac{1}{P} \sum_{i=1}^P (MI_{NL,i})} \quad (2)$$

where $MI_{Lk,n}$ is the MI value characterizing the n -th leak and the $MI_{NL,i}$ values are the P different MI computed for the non-leaking state.

It is worth noting that the practical implementation of the algorithm for an actual service pipe of the network requires the definition of a proper threshold associated with the starting condition, to be initialized on the basis of measurements upon the system installation. Actual leaks are expected to start with small cracks that grow over time. In such scenario, the algorithm is expected to give a warning when the current MI value (evaluated every night) crosses the defined threshold. Hence, the algorithm is expected to be effective for new leaks occurring after the threshold initialization as well as for leaks existing prior to the installation that grow over time.

Further statistical parameters, namely skewness and kurtosis, were also computed for all the acquisitions and investigated as possible alternative metrics for leak detection, although other experiments had not revealed any relevant correlation with the leaking conditions (Martini et al. 2014 and 2015).


The measured signals were also investigated in the frequency domain, to possibly identify distinctive leak signatures for enhancing the algorithm effectiveness. In particular, the power spectral density (PSD) was computed and analyzed over the available frequency range, namely between 10 Hz (a high-pass filter was applied due to the frequency response limits of the hydrophone) and 2560 Hz (i.e. $F_s/2$).

Results and discussion

The results provided by the algorithm applied to the signals of the hydrophone and the radial accelerometer, acquired for leak #1 and *Case-A* (water leaking against soil), are shown in Fig. 3, as examples. Each bar chart reports the comparison between the *MI* value computed for the leaking condition (*Lk #1*) and those for the non-leaking acquisitions (*NL #1-4*), normalized to the highest term. The *MI* values of the non-leaking state refer to the four distinct datasets acquired after repairing leaks 1-4 respectively. The corresponding *MIE* value (which in this analysis is computed by putting at the denominator the mean of the four *MI* values in non-leaking condition) is reported in the figure right upper corner.

The *MI* values in non-leaking conditions are comparable, i.e. the background noise exhibits basically constant levels during all tests. Figure 4 reports the comparison in the time domain of two measurements concerning leak #1, in leaking and non-leaking condition respectively, for the radial accelerometer and the hydrophone. As expected, the leaking flow induces higher signal levels. This results in a remarkable increment in the *MI* of the active leak, which permits the detection. As also expected, the results observed for the three sensors are quite different, since each sensor measures a different component of the axisymmetric waves associated with the vibro-acoustic energy flow

253 (Pavic 1992). This behavior is consistent with the results provided by other experimental studies
 254 (e.g. Hunaidi and Chu 1999). Table 2 reports the detection results (successful or failed detection)
 255 and the corresponding *MIE* obtained by running the algorithm on the data measured with the
 256 hydrophone and both the accelerometers for all leaks in *Case-A*. If the leak detection is missed, the
 257 *MIE* is set to zero. The detection is considered missed as well if the *MIE* value is lower than 1.5.
 258 This specific value was arbitrarily defined to assess the algorithm performance for the measured
 259 data. It was determined on the basis of the standard deviation of the $MI_{NL,i}$ values, which was found
 260 to be about 15% of the average, i.e. the denominator of Eq. (2), for all sensors. Accordingly, the
 261 adopted threshold was considered as the minimum value to achieve leak detection with an
 262 acceptably low probability of false positives. Nonetheless, a further tuning of the threshold would
 263 be reasonably required for the final implementation of the leak detection system, depending on the
 264 desired level of reliability and tolerance for false positives to be achieved.

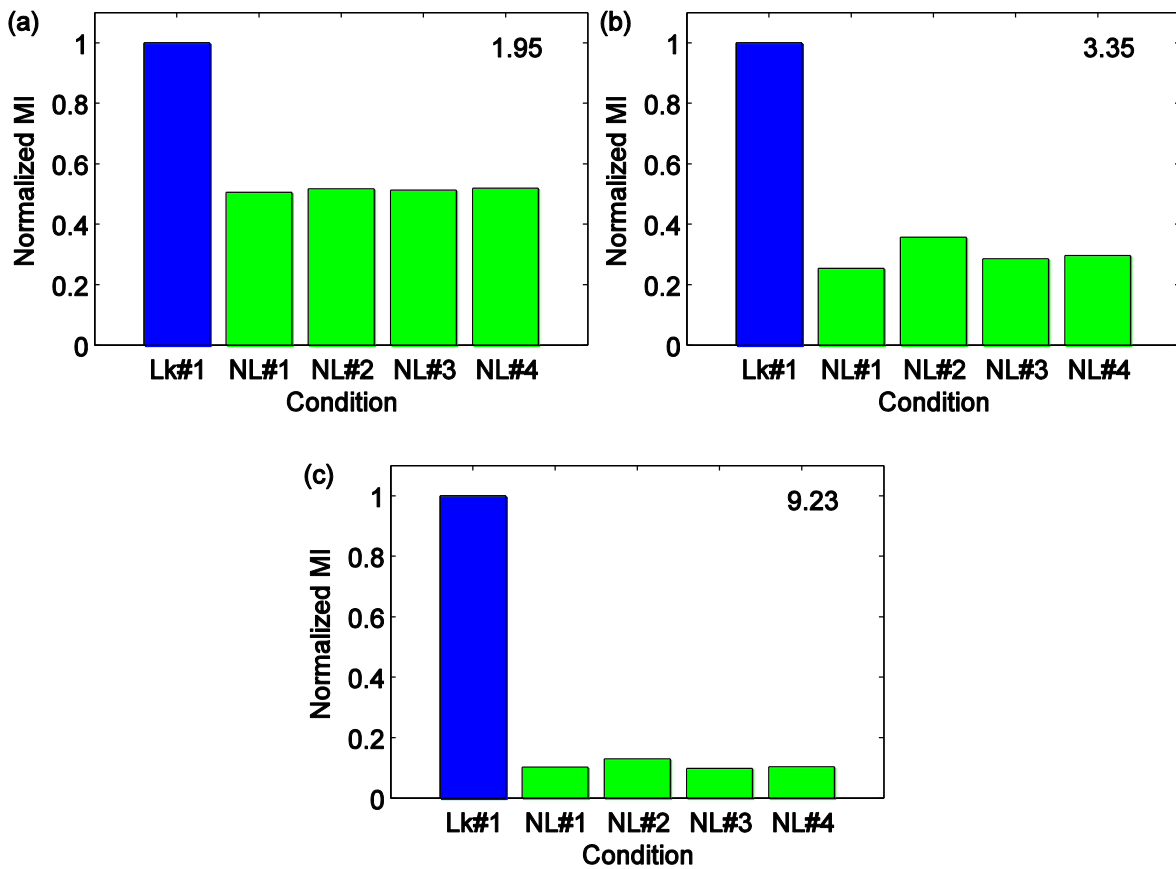

266
 267 **Fig. 3.** *MI* computed for leak #1 in *Case-A* with raw signals of (a) radial accelerometer, (b)
 268 hydrophone and (c) axial accelerometer

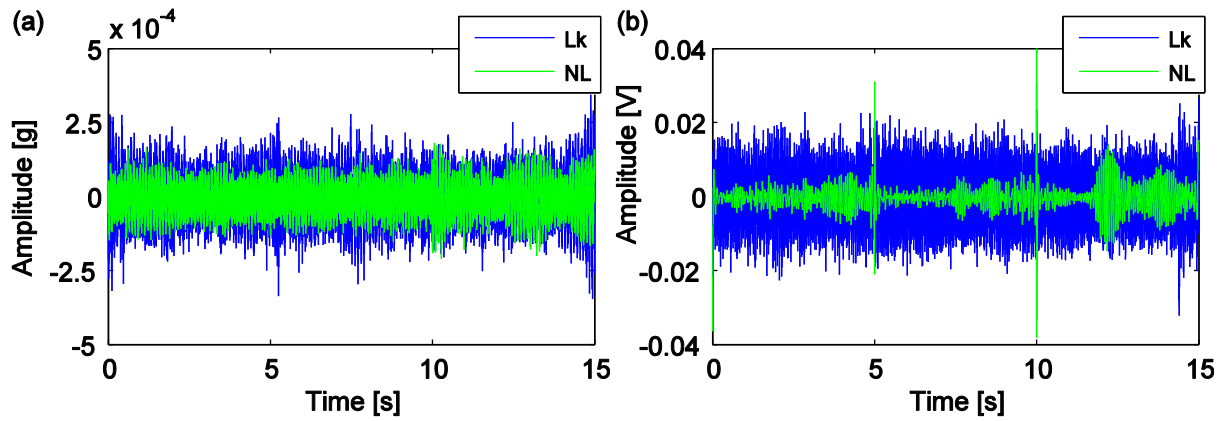


Fig. 4. Comparison between time histories measured for non-leaking condition and for leak #1 in *Case-A* by (a) radial accelerometer and (b) hydrophone

Table 2. Results of the algorithm applied to raw signals of accelerometers and hydrophone, *Case-A*

Leak	Distance [m]	Flow rate [l/h]	Radial accelerometer		Axial accelerometer		Hydrophone	
			Detection	MIE	Detection	MIE	Detection	MIE
#1	3	200	yes	1.95	yes	9.23	yes	3.35
#2	8	295	yes	1.94	yes	5.72	yes	2.95
#3	13	200	no	1.19	yes	1.52	yes	1.67
#4	18	180	no	1.05	no	0	no	0
#5	26	4000	no	1.08	no	0	yes	20.42

The performance of the algorithm based on radial accelerations is rather poor. Only the two nearest leaks are detected, and with a very low efficiency (a *MIE* lower than 2.5 being considered not completely satisfactory).

Better results are achieved with the axial accelerometer and the hydrophone, both exhibiting a similar behavior except for leak #5. Indeed such leak, which presents a high flow rate, is detected only with the hydrophone.

The analysis of the data acquired in *Case-B* (water leaking into air) reveals that the signal levels associated with active leaks are remarkably lower than in *Case-A*. The comparisons of the *MI* values computed for the signals of the hydrophone and the radial accelerometer acquired for leak #1

are reported in Fig. 5, as examples. The increment in the signal STD (with respect to the non-leaking condition) is significantly reduced. This causes the algorithm to fail the detection of almost all leaks, regardless of the considered transducer. Such a behavior is consistent with other experimental studies found in the literature (e.g. Thompson et al. 2001), which reported that water leaking against soil may appear noisier. Hence these results confirms that the medium surrounding the leaking pipe represent a chief factor for the generation of leak-related noise. However, service pipes are normally buried from their connections with the water main to the manholes where the customers' water meters are installed, thus leaks exposed to air being much less likely to occur in the system of interest. Reasonably, leaks possibly starting in the terminal unburied sections of service pipes (typically shorter than 1 m) would be extremely close to the monitoring sensors and therefore easily detected as well. Therefore, the analysis will focus on the test condition *Case-A* hereafter.

The investigation in the frequency domain takes into account the same subset of acquisitions considered for computing the *MI*. The main objective is the definition of a proper filtering technique for enhancing both the algorithm effectiveness (i.e. the number of leaks successfully detected) and efficiency (given by the *MIE* value).

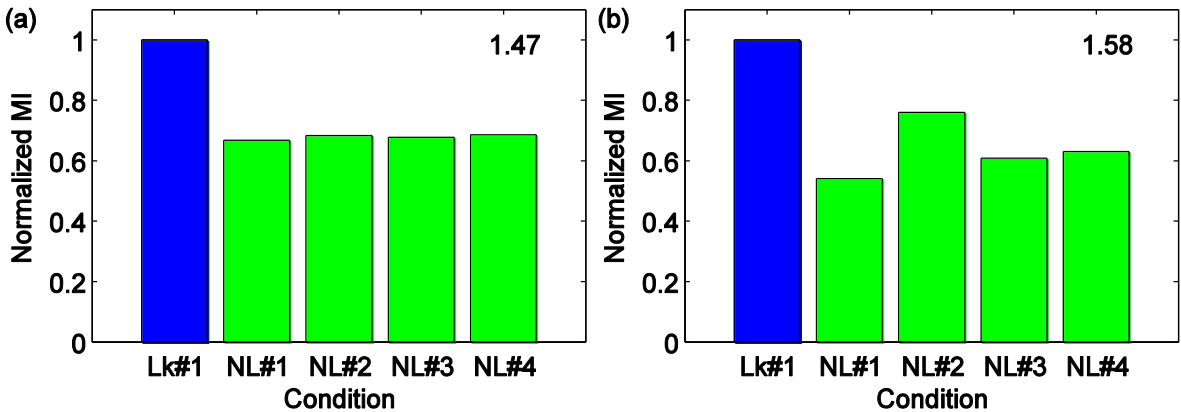


Fig. 5. *MI* computed for leak #1 in *Case-B* with raw signals of (a) radial accelerometer and (b) hydrophone

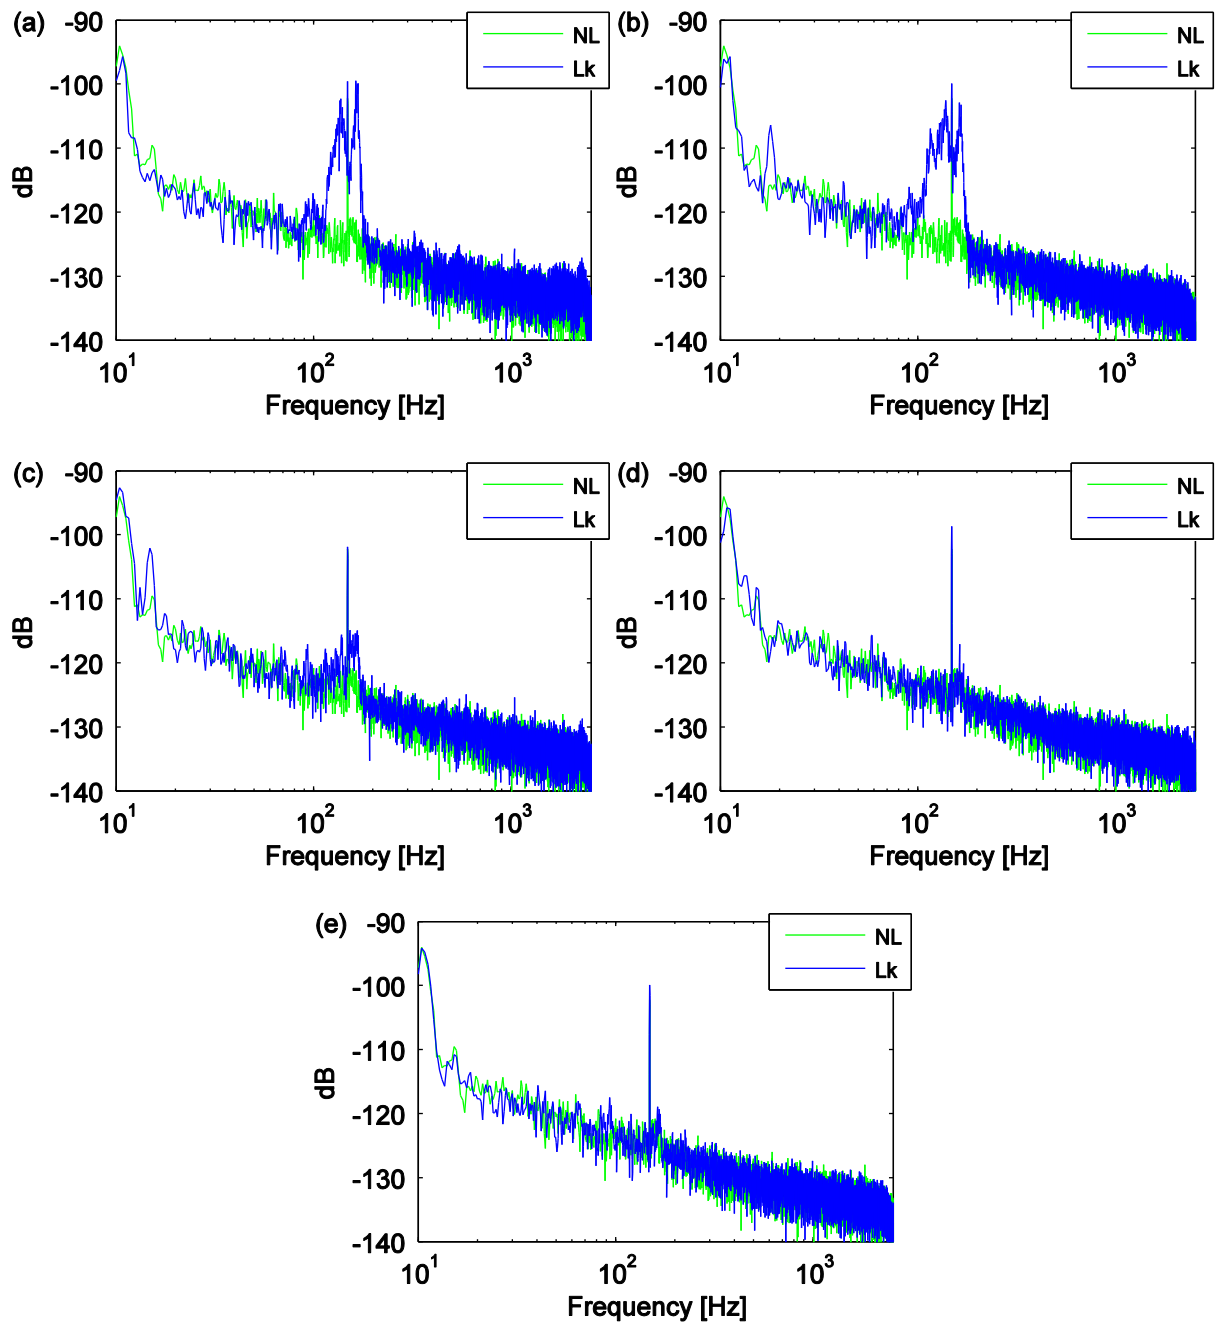


Fig. 6. Comparison of the PSDs of the radial accelerometer signals in leaking condition (Lk), for leaks (a) #1, (b) #2, (c) #3, (d) #4, (e) #5, with the PSD computed for non-leaking acquisitions (NL)

The comparison between the PSD of two signals, one concerning the leaking (Lk) and one for the non-leaking (NL) conditions of all transducers, is shown in Figs. 6-8 for all leaks. The results focus on the range up to 1200 Hz, since no significant frequency content was observed above this limit.


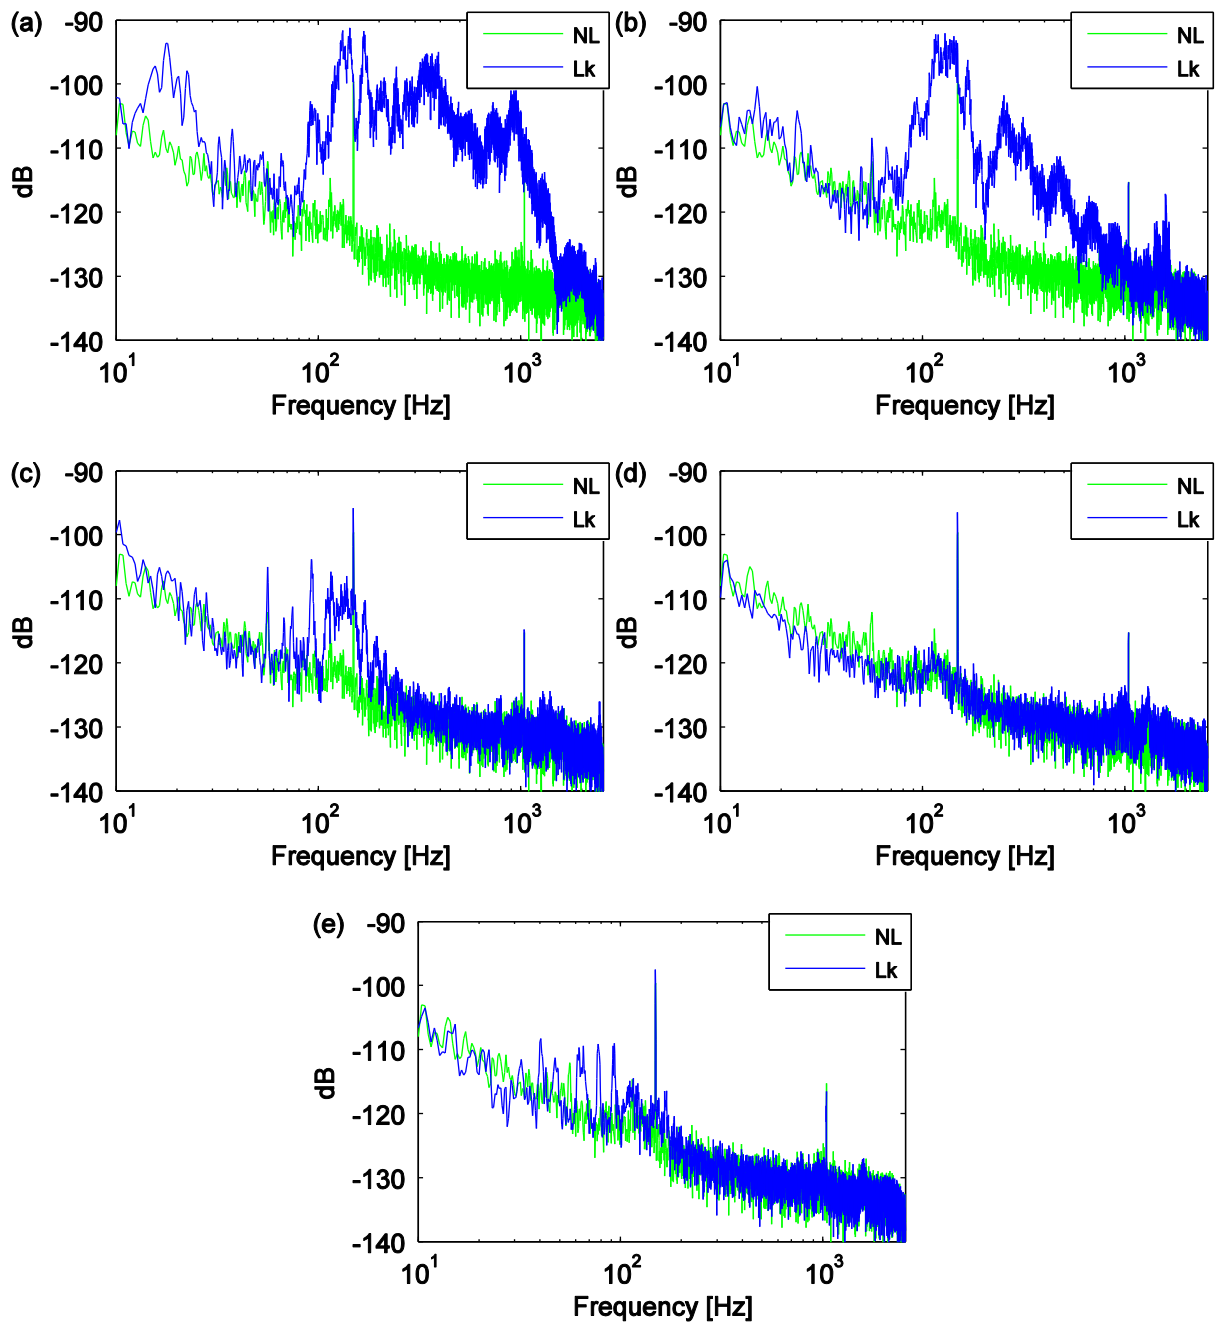


Fig. 7. Comparison of the PSDs of the axial accelerometer signals in leaking condition (Lk), for leaks (a) #1, (b) #2, (c) #3, (d) #4, (e) #5, with the PSD computed for non-leaking acquisitions (NL)

Vibrations induced by the nearest leaks to the measuring point appear clearly distinguishable from the environmental noise with all transducers. The frequency content of the radial accelerometer signal is characterized by a rather narrow bandwidth, between 100 and 200 Hz (Fig. 6). Conversely, the axial accelerometer and the hydrophone exhibit a much wider spectrum, up to 1 KHz (Figs. 7, 8). As the leak distance grows, the PSD amplitude decreases and high frequencies are

323 damped. This phenomenon affects the signals of all transducers, but it is more evident for the
 324 accelerometers. Consequently, accelerometers appear unable to measure the vibrations related to the
 325 most distant leaks.

326

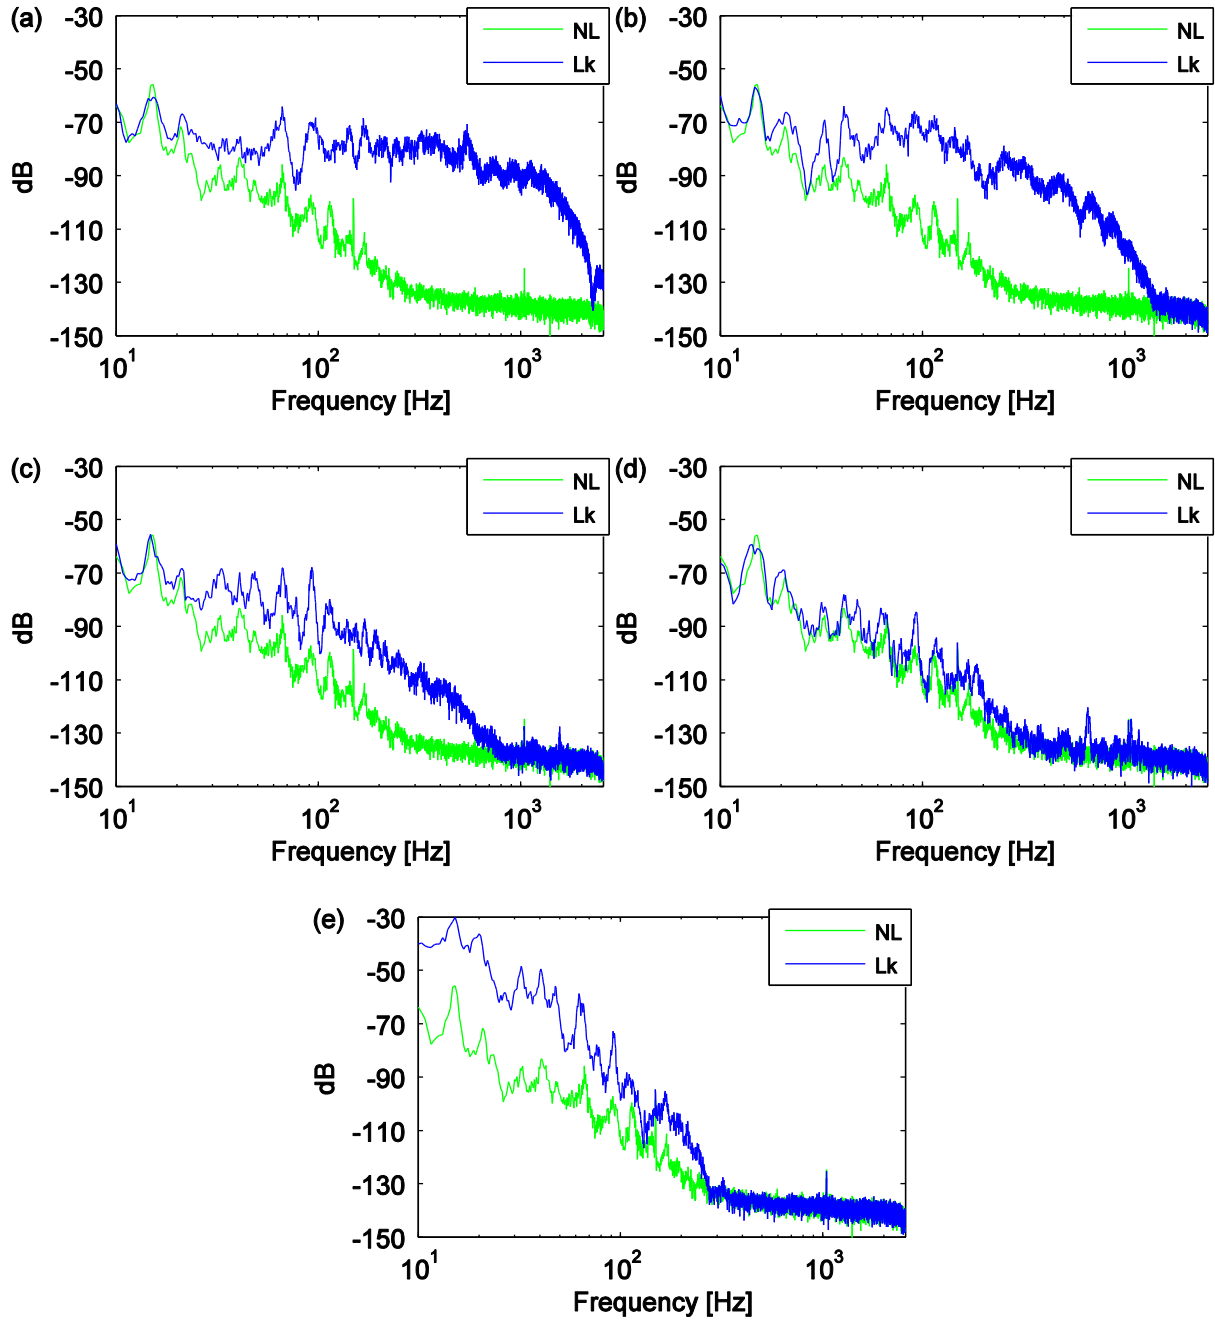

327

328

329

330 **Fig. 8.** Comparison of the PSDs of the hydrophone signals in leaking condition (Lk), for leaks (a)
 331 #1, (b) #2, (c) #3, (d) #4, (e) #5, with the PSD computed for non-leaking acquisitions (NL)

332 Spectral analysis permits to identify, for each transducer, some frequency bands in which the
333 frequency content associated with the leaks is more evident. Different filters based on such
334 frequency bands were tested for re-processing the measured signals before running the algorithm.

335 The results provided by the algorithm after applying a 100-600 Hz band-pass filter, namely a
336 zero-phase digital Finite Impulse Response (FIR) filter, are reported in Table 3. As for the
337 hydrophone, signal filtering permits to detect all leaks. The algorithm efficiency is remarkably
338 enhanced for all leaks except for the most distant one. Indeed the hydrophone signals associated
339 with leak #5 exhibit a peak of the spectrum in the band 10-60 Hz which is reasonably related to the
340 higher leaking flow rate, since it is not observed in any other acquisition. Such frequency content is
341 cut off by the adopted filter, thus causing the *MIE* to lower.

342 An improvement in the algorithm efficiency is achieved with the filtered signals of both
343 accelerometers as well. As far as the axial accelerometer is concerned, the algorithm effectiveness is
344 also enhanced, leak #3 being successfully detected. However, the detection of distant leaks is still
345 missed with both accelerometers. The axisymmetric waves $s=1$ and $s=2$ (namely the fluid-borne
346 wave and pipe vibrations respectively) would be expected to be rather strongly coupled under the
347 boundary conditions considered in the experiment (Muggleton et al. 2002). Nonetheless only the
348 fluid-borne wave could reach the measuring point for the most distant leaks, whereas the
349 propagation of shell vibrations was reasonably prevented by the high attenuation of the pipe
350 material (even if the experimental setup did not allowed to directly estimate the actual pipe
351 damping). Further enhancements of the leak detection range seem hardly achievable for vibration
352 measurements, since the same attenuation effects are reasonably expected to occur in buried pipe
353 systems with similar features. However the range of effectiveness provided by the accelerometers
354 (both the axial and the radial one) should be sufficient for the majority of the service pipes that may
355 be found in actual networks, these typically being about 10 m long. Hence the requirements of the
356 leak detection system to be developed by Hera S.p.A would be met.


357 **Table 3.** Results of the algorithm applied to band-pass filtered signals (100-600 Hz filter)

Leak	Distance [m]	Flow rate [l/h]	Radial accelerometer		Axial accelerometer		Hydrophone	
			Detection	MIE	Detection	MIE	Detection	MIE
#1	3	200	yes	2.77	yes	13.17	yes	144.60
#2	8	295	yes	2.73	yes	8.83	yes	91.85
#3	13	200	no	1.08	yes	1.70	yes	15.49
#4	18	180	no	1.11	no	1.11	yes	2.17
#5	26	4000	no	1.07	no	1.10	yes	6.24

358


359 The presented results prove signal filtering an effective strategy to enhance the performance
 360 of the prototypal leak detection algorithm for the acquisitions of both the hydrophone and the
 361 accelerometers. However, it is worth noting that the frequency content of vibro-acoustic signals
 362 associated with leaks may result partially altered in actual service pipes, due to different boundary
 363 condition. Hence a preliminary analysis of leak-related measurements performed in the actual water
 364 distribution network is advisable, in order to further refine and test both the algorithm and the
 365 filters.

366 As for the other investigated statistical parameters, skewness and kurtosis were computed
 367 for the complete datasets, by taking into account both the raw and the filtered signals. Figures 9 and
 368 10 report the comparison between skewness and kurtosis, respectively, computed for the raw
 369 signals related to leak #1 and to the non-leaking acquisitions, for the radial accelerometer and the
 370 hydrophone, chosen as examples. In particular, the results concerning the ten acquisitions with the
 371 lowest STD are only shown, for a better readability. No significant correlations can be identified,
 372 either between leaking and non-leaking conditions or even between the different datasets of the
 373 non-leaking state. Similar results are obtained for all the other analyzed conditions. Hence,
 374 skewness and kurtosis are confirmed as unsuitable metrics for leak detection purpose.

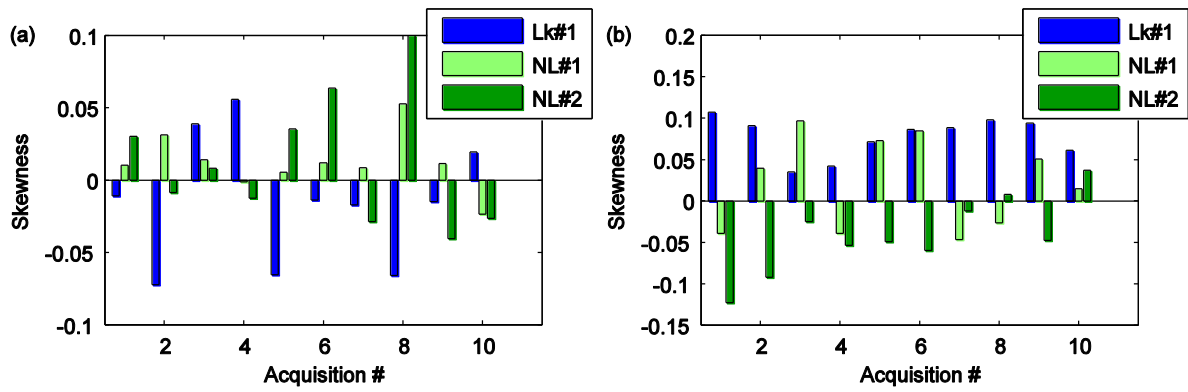

375

376 **Fig. 9.** Skewness associated with leak #1 (Lk#1) and 2 non-leaking datasets (NL#1 and 2),
 377 computed for the 10 raw signals with lowest STD of (a) radial accelerometer and (b) hydrophone.

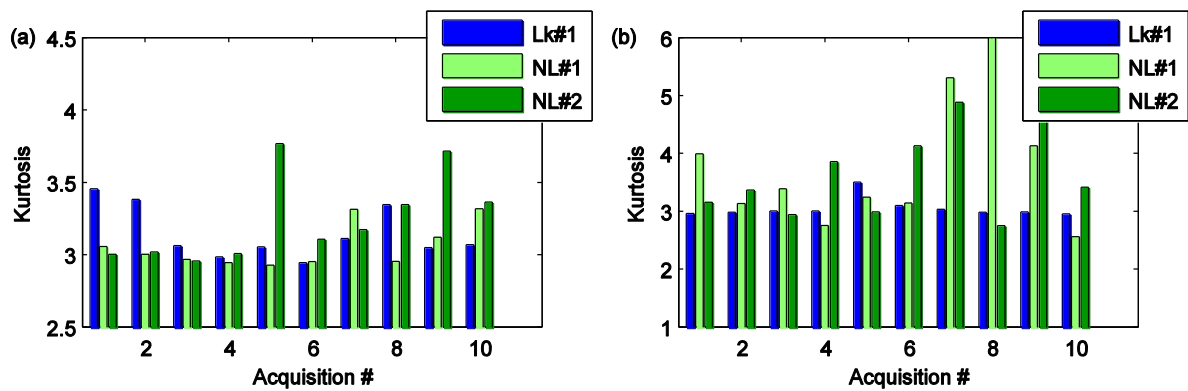

378

379 **Fig. 10.** Kurtosis associated with leak #1 (Lk#1) and 2 non-leaking datasets (NL#1 and 2),
 380 computed for the 10 raw signals with lowest STD of (a) radial accelerometer and (b) hydrophone.

381 Conclusion

382 Experimental tests were carried out in order to compare the effectiveness of measurements
 383 of different vibro-acoustic phenomena for detecting water leaks occurring in plastic service pipes.
 384 Leaks were artificially induced on a small-diameter polyethylene pipe. Vibro-acoustic signals
 385 related to the leaks were monitored by using a hydrophone and two accelerometers.

386 The most satisfactory results were provided by the hydrophone, which was able to clearly
 387 "hear" the noise generated by even the most distant leaking flows. The hydrophone measurements
 388 permitted to attain the detection of all generated leaks with excellent reliability. In addition, a

389 simple prototypal algorithm which exploits STD of the hydrophone signals for achieving automatic
390 leak detection was successfully tested on all leaks.

391 Satisfactory results were provided by the accelerometers as well. As expected, the axial
392 accelerometer proved more sensitive to the leaks than the radial one. Measurements of the axial
393 vibrations, processed by running the prototypal algorithm, allowed a successful detection of the
394 three nearest leaks (one more than by using radial vibrations). None of the accelerometers permitted
395 to detect the most distant leaks and further improvements of the detection effectiveness appear
396 difficult to be achieved, due to high attenuation of acceleration signals in the pipe wall.
397 Nonetheless, the accelerometers appeared suitable to be adopted for the leak detection system to be
398 developed by Hera S.p.A. Indeed, they permitted to detect leaks over a distance range that should be
399 adequate for most of the service pipes in the water supply network managed by the utility, in
400 particular when proper signal filtering techniques were adopted for improving the performance of
401 the prototypal detection algorithm. Moreover, since accelerometers are ordinarily cheaper than
402 hydrophones, they appear economically more convenient to be adopted on a large scale.

403 A pilot experimental campaign on actual service pipes of the water distribution network has
404 been started for testing a prototypal detection system based on measurements of leak-related pipe
405 vibrations with accelerometers (Martini et al. 2015). The first results are promising and confirm
406 both the effectiveness and the reliability of the developed system.

407 **Acknowledgments**

408 This activity was performed in collaboration with Hera S.p.A. (Bologna, Italy), that is
409 gratefully acknowledged for operative cooperation, use of facilities, and financial support.

410 **References**

411 Anastasopoulos, A., Kourousis, D., and Bollas, K. (2009). “Acoustic emission leak detection of liquid
412 filled buried pipeline.” *J. Acoust. Emission*, 27, 27–39.

413 BDEW (German Association of Energy and Water Industries). (2010). "VEWA Survey: Comparison
414 of European Water and Waste water Prices." www.bdew.de (Apr. 5, 2016).

415 Bimpas, M., Amditis, A., and Uzunoglu, N. (2010). "Detection of water leaks in supply pipes using
416 continuous wave sensor operating at 2.45 GHz." *J. Appl. Geophys.*, 70, 226–236.

417 Butler, D. (2000). *Leakage Detection and Management*, Palmer Environmental, Cwmbran, U. K.

418 Cataldo, A., Persico, R., Leucci, G., De Benedetto, E., Cannazza, G., Matera, L., and De Giorgi, L.
419 (2014). "Time domain reflectometry, ground penetrating radar and electrical resistivity
420 tomography: A comparative analysis of alternative approaches for leak detection in underground
421 pipes." *NDT&E Int.*, 62, 14–28.

422 CEN (European Committee for Standardization). (2000). "Water supply - Requirements for systems
423 and components outside buildings." EN 805:2000, Brussels, Belgium.

424 Colombo, A. F., Lee, P., and Karney, B. W. (2009). "A selective literature review of transient based
425 leak detection methods." *J. Hydro-Environ. Res.*, 2(4), 212–227.

426 EPA (United States Environmental Protection Agency). (2010). "Control and Mitigation of Drinking
427 Water Losses in Distribution Systems." *EPA/816/R-10/019 report*.

428 Fahmy, M., and Moselhi, O. (2009). "Detecting and locating leaks in Underground Water Mains
429 Using Thermography." *Proc., 26th Int. Symposium on Automation and Robotics in Construction*
430 *(ISARC 2009)*, Austin, Texas, USA, 61–67.

431 Fuller, R., and Fahy, F. J. (1982). "Characteristics of wave propagation and energy distributions in
432 cylindrical elastic shells filled with fluid." *J. Sound Vib.*, 81(4), 501–518.

433 Gao, Y., Brennan, M. J., Joseph, P. F., Muggleton, J. M., and Hunaidi, O. (2004). "A model of the
434 correlation function of leak noise in buried plastic pipes." *J. Sound Vib.*, 277, 133–148.

435 Gao, Y., Brennan, M. J., Joseph, P. F., Muggleton, J. M., and Hunaidi, O. (2005). "On the selection
436 of acoustic/vibration sensors for leak detection in plastic water pipes." *J. Sound Vib.*, 283(3–5),
437 927–941.

438 Ghazali, M. F., Beck, S. B. M., Shucksmith, J. D., Boxall, J. B., and Staszewski, W. J. (2012).
 439 “Comparative study of instantaneous frequency based methods for leak detection in pipeline
 440 networks.” *Mech. Syst. Signal Process.*, 29 , 187–200.

441 Hunaidi, O., and Chu, W. T. (1999). “Acoustical characteristics of leak signals in plastic water
 442 distribution pipes.” *Appl. Acoust.*, 58, 235–254.

443 Hunaidi, O., Chu, W., Wang, A., and Guan, W. (2000). “Detecting leaks in plastic pipes.” *J. AWWA*,
 444 92(2), 82–94.

445 Hunaidi, O. (2012). “Acoustic leak detection survey strategies for water distribution pipes.” *J. Constr.*
 446 *Technol. Update*, 79, 1-5.

447 Kanakoudis, V. K., and Tolikas, D. K. (2001). “The role of leaks and breaks in water networks –
 448 technical and economical solutions.” *J. Water Supply: Res. Technol. - AQUA*, 50(5), 301–311.

449 Kanakoudis, V. K. (2004). “A troubleshooting manual for handling operational problems in water
 450 pipe networks.” *J. Water Supply: Res. Technol. - AQUA*, 53(2), 109-124.

451 Kanakoudis, V., and Tsitsifli, S. (2010). “Results of an urban water distribution network performance
 452 evaluation attempt in Greece”, *Urban Water J*, 7(5), 267-285,

453 Kanakoudis, V., Tsitsifli, S., Samaras, P. and Zouboulis, A. (2013). “Assessing the performance of
 454 urban water networks across the EU Mediterranean area: The paradox of high NRW levels and
 455 absence of NRW reduction measures planning”, *Water Sci. Technol.: Water Supply*, 13(4), 939-
 456 950.

457 Kanakoudis, V., and Muhammetoglu, H. (2014). “Urban water pipe networks management towards
 458 NRW reduction: two case studies from Greece & Turkey.” *CLEAN – Soil, Air, Water*, 42(7), 880-
 459 892.

460 Kanakoudis, V., and Tsitsifli, S. (2014). “Using the Bimonthly WB of a Non-Fully Monitored Water
 461 Distribution Network with Seasonal Water Demand Peaks to define its Actual NRW Level: The
 462 case of Kos Town, Greece.” *Urban Water J*, 11(5), 348-360.

463 Khulief, Y. A., Khalifa, A., Ben Mansour, R., and Habib, M. A. (2012). "Acoustic Detection of Leaks
464 in Water Pipelines Using Measurements inside Pipe." *J. Pipeline Syst. Eng. Pract.*, 3(2), 47–54.

465 Leoni, G., Anzalone, C., Giunchi, D., and Nascetti, D. (2009). "Method for detecting the presence of
466 leaks in a water distribution network and kit for applying the method". *European Patent No.*
467 *2.107.357*.

468 Liu, Z., Kleiner, Y., Rajani, B., Wang, L., and Condit, W. (2012). Condition assessment technologies
469 for water transmission and distribution systems. EPA – U. S. Environmental Protection Agency,
470 Washington, DC, *EPA/600/R-12/017 report*.

471 Martini, A., Troncossi, M., Rivola, A., and Nascetti, D. (2014). "Preliminary investigations on
472 automatic detection of leaks in water distribution networks by means of vibration monitoring."
473 *Advances in Condition Monitoring of Machinery in Non-Stationary Operations (Lecture Notes in*
474 *Mechanical Engineering)*, Springer, Germany, 535-544.

475 Martini, A., Troncossi, M., and Rivola, A. (2015). "Automatic Leak Detection in Buried Plastic Pipes
476 of Water Supply Networks by Means of Vibration Measurements." *Shock Vib.*,
477 10.1155/2015/165304, 1–13.

478 Metje, N., Atkins, P. R., Brennan, M. J., Chapman, D. N., Lim, H. M., Machell, J., Muggleton, J.
479 M., Pennock, S., Ratcliffe, J., Redfern, M., Rogers, C. D. F., Saul, A. J., Shan, Q., Swinger,
480 S., and Thomas, A. M. (2007). "Mapping the Underworld – State-of-the-art review." *Tunnelling*
481 *Underground Space Technol.*, 22, 568–586.

482 Miller, R. K., Pollock, A. A., Watts, D. J., Carlyle, J. M., Tafuri, A. N. and Yezzi, J. J. Jr. (1999) "A
483 reference standard for the development of acoustic emission pipeline leak detection techniques."
484 *NDT&E Int.*, 32, 1–8.

485 Muggleton, J. M., Brennan, M. J., and Pinnington, R. J. (2002). "Wavenumber Prediction of Waves
486 in Buried Pipes for Water Leak Detection." *J. Sound Vib.*, 249(5), 939–954.

487 Muggleton, J. M., Brennan, M. J. (2005). "Axisymmetric wave propagation in buried, fluid-filled
488 pipes: effects of wall discontinuities." *J. Sound Vib.*, 281, 849–867.

489 Pal, M., Dixon, N., and Flint, J. (2010). "Detecting & Locating Leaks in Water Distribution
490 Polyethylene Pipes." *Proc. World Cong. on Engineering 2010 Vol. II*, London, U.K., 889–894.

491 Papastefanou, A. S., Joseph, P. F., and Brennan, M. J. (2012). "Experimental Investigation into the
492 Characteristics of In-Pipe Leak Noise in Plastic Water Filled Pipes." *Acta Acust. United Acust.*,
493 98, 847–856.

494 Pavic, G. (1992). "Vibroacoustical energy flow through straight pipes." *J. Sound Vib.*, 143(3), 411–
495 429.

496 Suzuki, T., Ikeda, Y., Tomoda, Y., and Ohtsu, M. (2005). "Water-Leak Evaluation Of Existing
497 Pipeline By Acoustic Emission." *J. Acoust. Emission*, 23, 272–276.

498 Thompson, M., Allwright, D. J., Chapman, C. J., Howison, S. D., and Ockendon, J. R. (2001). "Noise
499 generation by water pipe leaks." *Study report of 40th European Study group with industry*, 1–6.

500 Vahaviolos, S. J., Miller, R. K., Watts, D. J., Shemyakin, V. V., and Strizkov, S. A. (2001). "Detection
501 and Location of Cracks and Leaks in Buried Pipelines Using Acoustic Emission." *J. Acoust.*
502 *Emission*, 19, 172–183.

503 Yazdekhasti, S., Piratla, K. R., Atamturktur, S. and Khan, A. (2016). "Novel vibration-based
504 technique for detecting water pipeline leakage." *Struct. Infrastruct. Eng.*, in press,
505 DOI:10.1080/15732479.2016.1188318.

506